



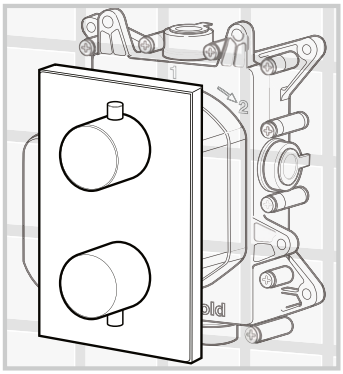
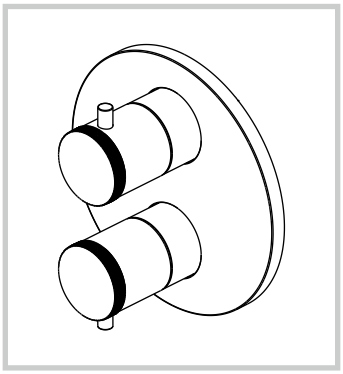
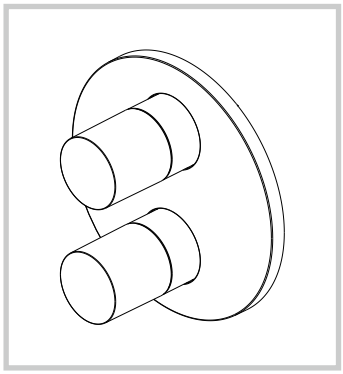
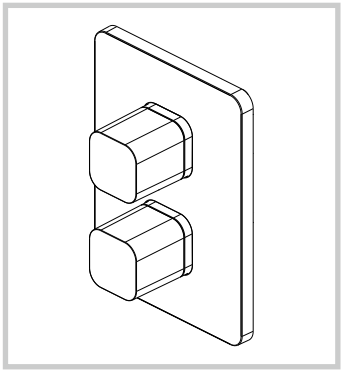
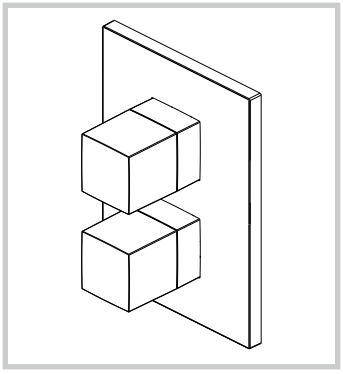


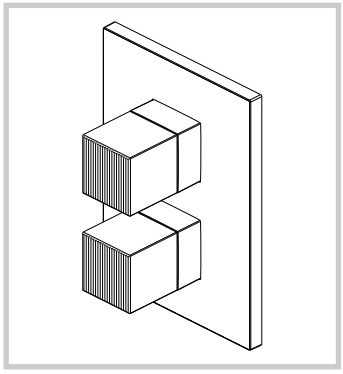

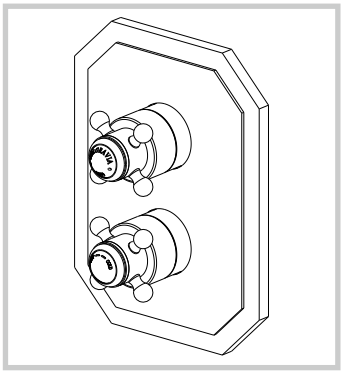

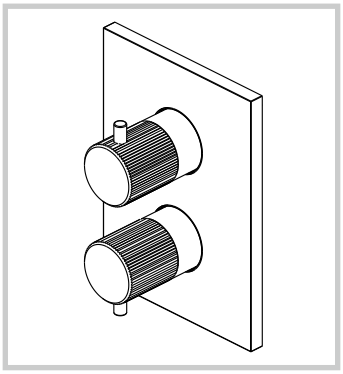

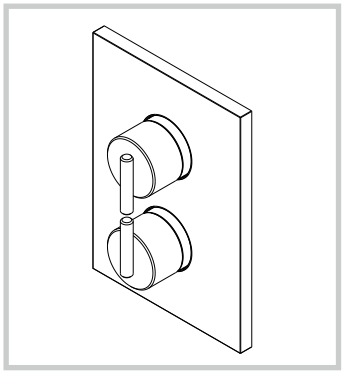

COMPLETION CONCEALED BOX

MOUNTING INSTRUCTIONS

1 TECHNICAL FEATURES

Pressure range min/max 0,5/5 bar
(in case of water pressure highter than 5 bar weeracommend installing pressure reducers).
Recommended pressure 3 bar.

Operation:
Either with gas or electric accumulation boilers.
Centralised systems.





The product should only be installed by a suitably qualified plumber/installer.




Safety lock at:	41° C
Min. Working temperature:	3° C
Min. recommended:	15° C
Max. Working temperature:	70° C
Max. recommended:	65° C
Recommended thermal differential	50° C

Thermal disinfection is allowed.


Safety system with flow stop in case of lack of one of the two waters.


Warning: contact the plumber for the choice of the best water heating device.


Press.	FLOW RATE (L/min)			
	Term. 1 way	Term. 2 way		
				
bar	Exit 1/2/3	Exit 2	Exit 3	Mix
0,5	8,2	8,2	8,2	9,2
1	11,7	11,7	11,7	13,2
2	16,7	16,4	16,4	18,7
3	20,7	20	20	22,9
4	24	23	23	26,4
5	26,6	25,8	25,8	29,5


Press.	FLOW RATE (L/min)		
	Term. 3 ways		
			
bar	Exit 1	Exit 2	Exit 3
0,5	9,4	8,1	8,1
1	13,4	11,6	11,6
2	19,2	16,6	16,6
3	23,7	20,5	20,5
4	27,4	23,8	23,8
5	30,5	26,6	26,6

4 PRE-INSTALLATION INFORMATIONS

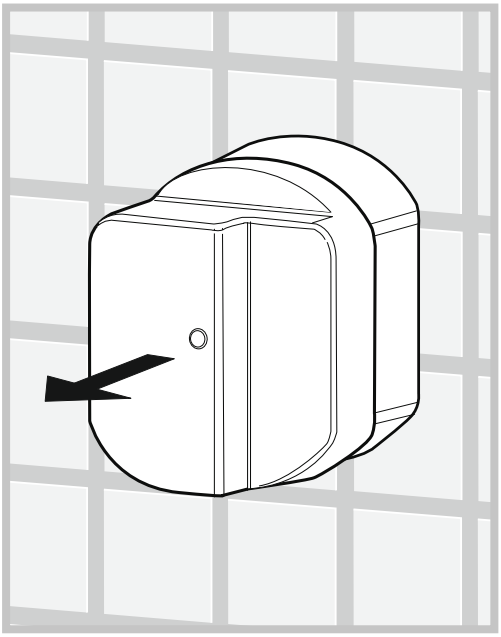


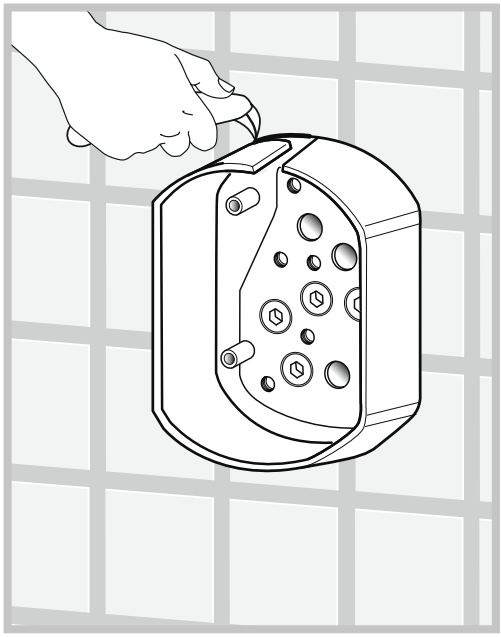


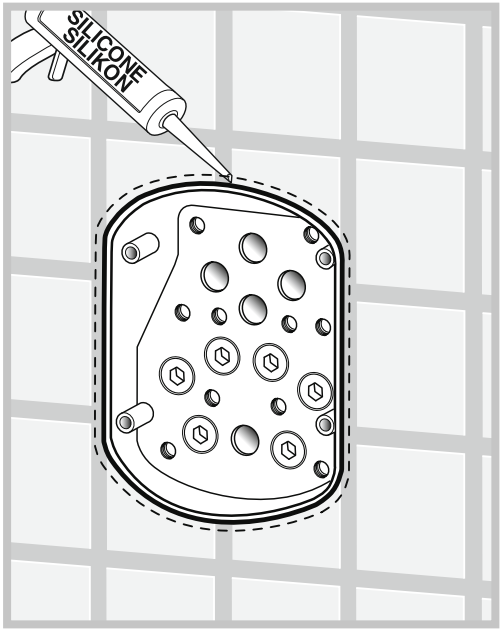

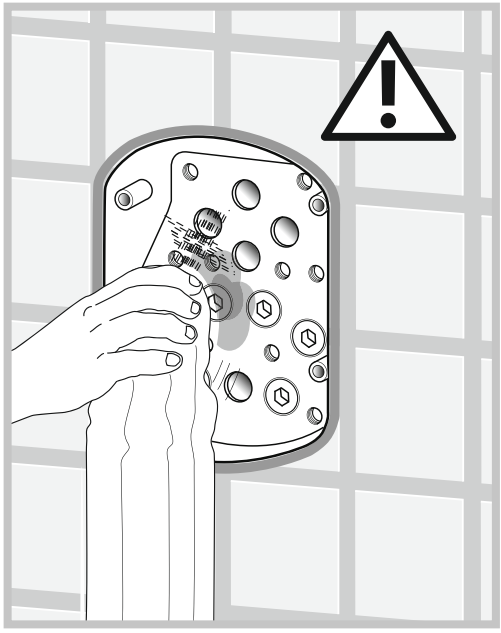


5 PACKAGE CONTENT - THERMOSTATIC 1-2-3 WAYS




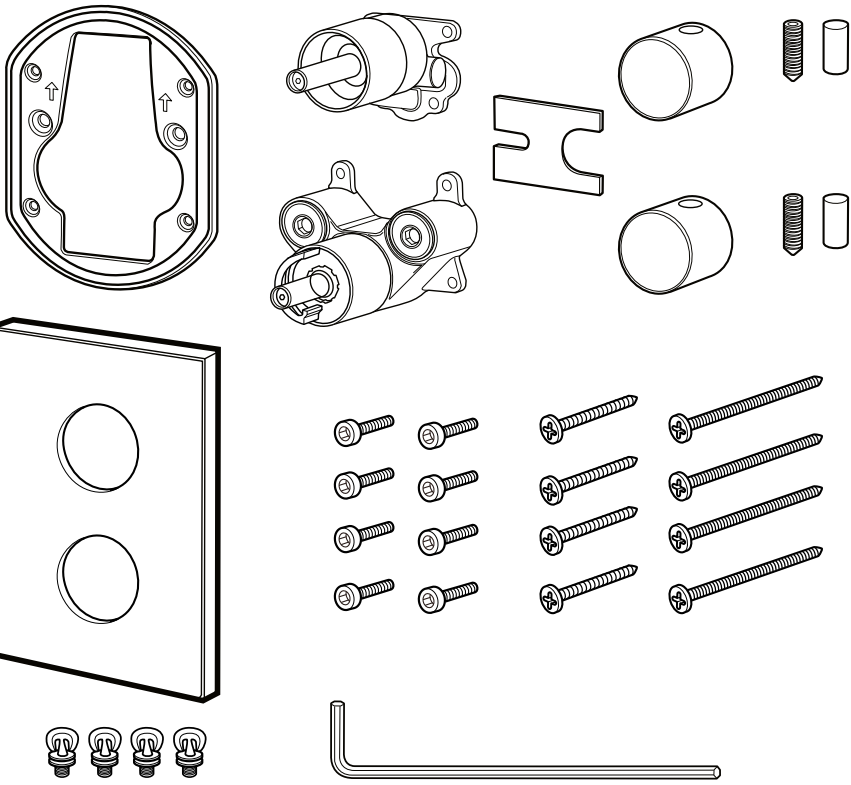

GB Mounting Instructions


6 PACKAGE CONTENT - THERMOSTATIC 1-2-3 WAYS




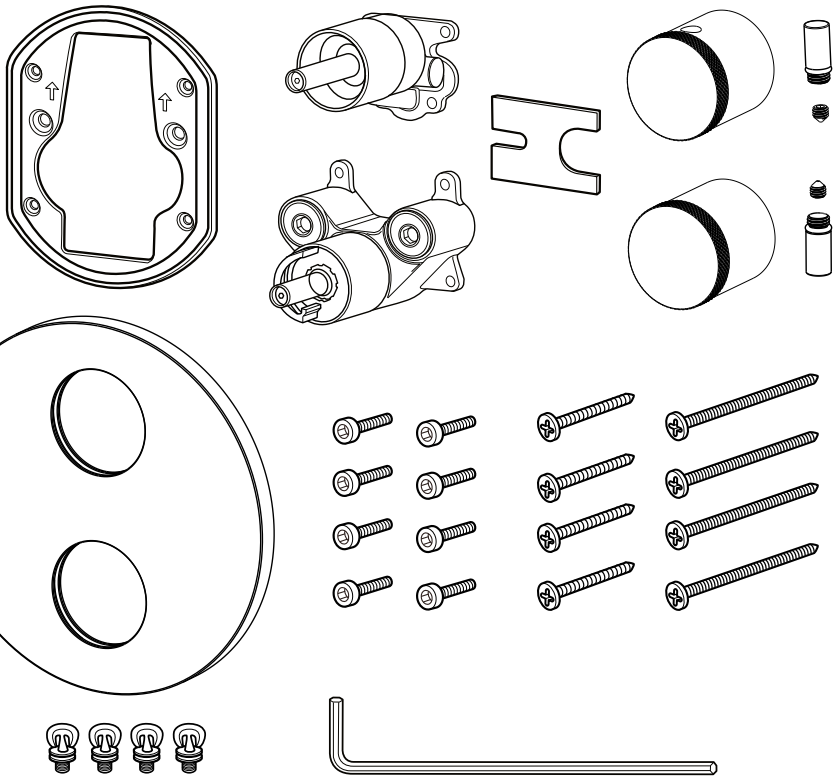

GB Mounting Instructions


7 PACKAGE CONTENT - THERMOSTATIC 1-2-3 WAYS

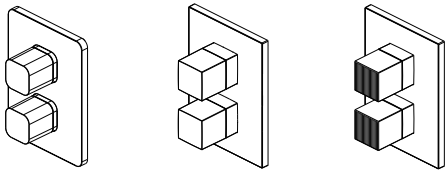


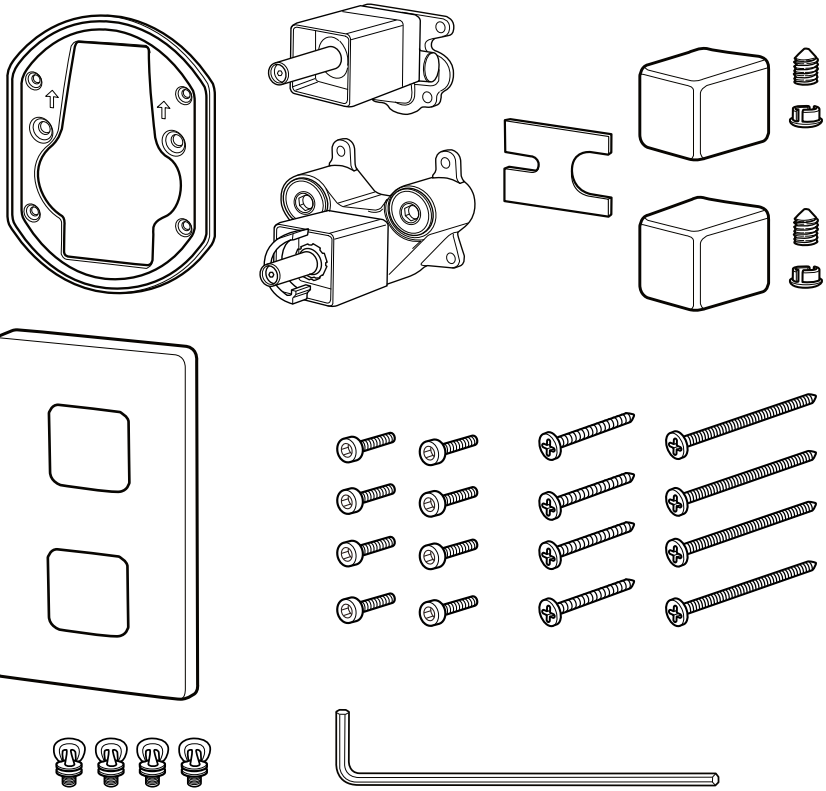

GB Mounting Instructions


8 PACKAGE CONTENT - THERMOSTATIC 1-2-3 WAYS




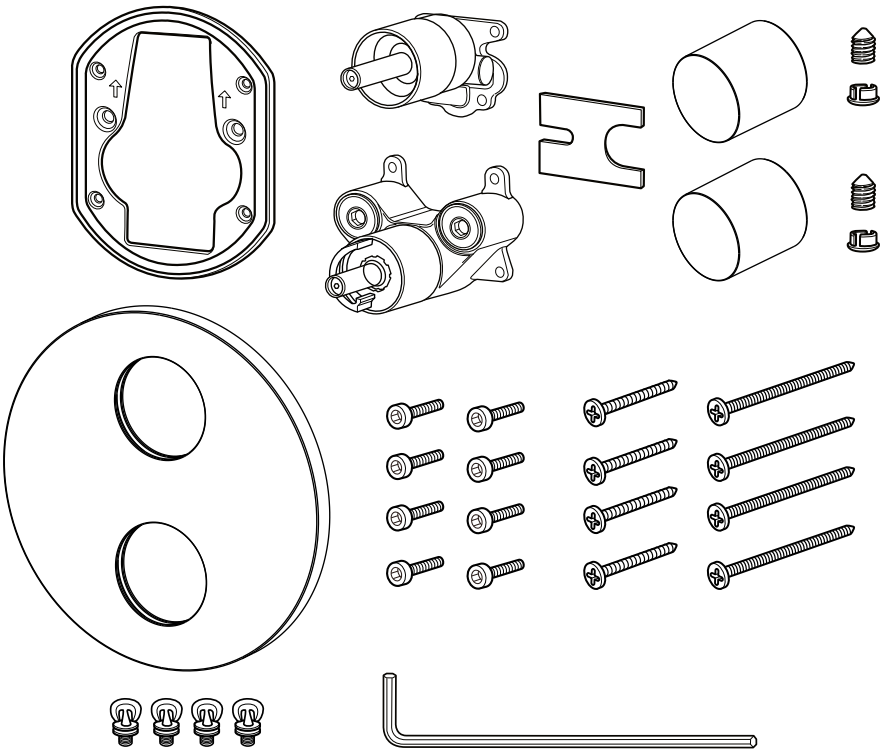

GB Mounting Instructions


9 PACKAGE CONTENT - THERMOSTATIC 1-2-3 WAYS




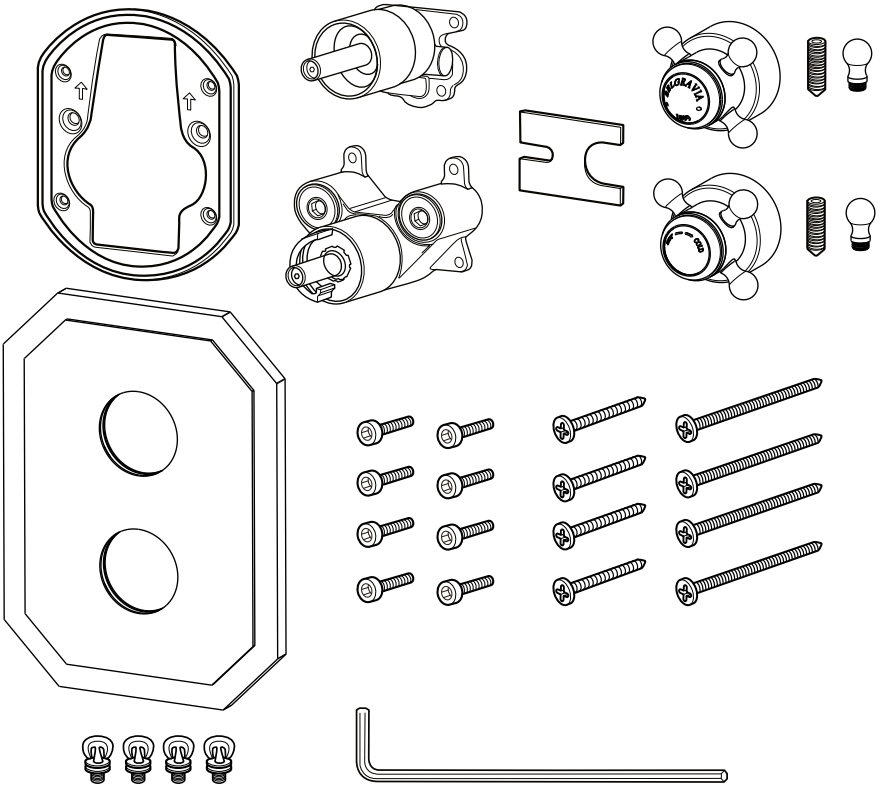

GB Mounting Instructions


10 PACKAGE CONTENT - THERMOSTATIC 1-2-3 WAYS




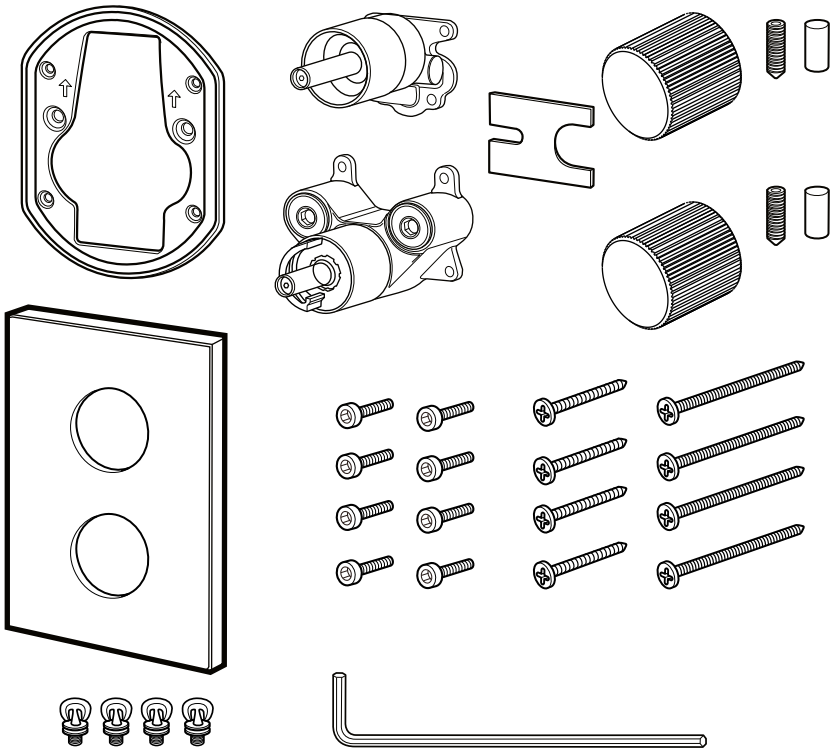

GB Mounting Instructions


11 PACKAGE CONTENT - THERMOSTATIC 1-2-3 WAYS



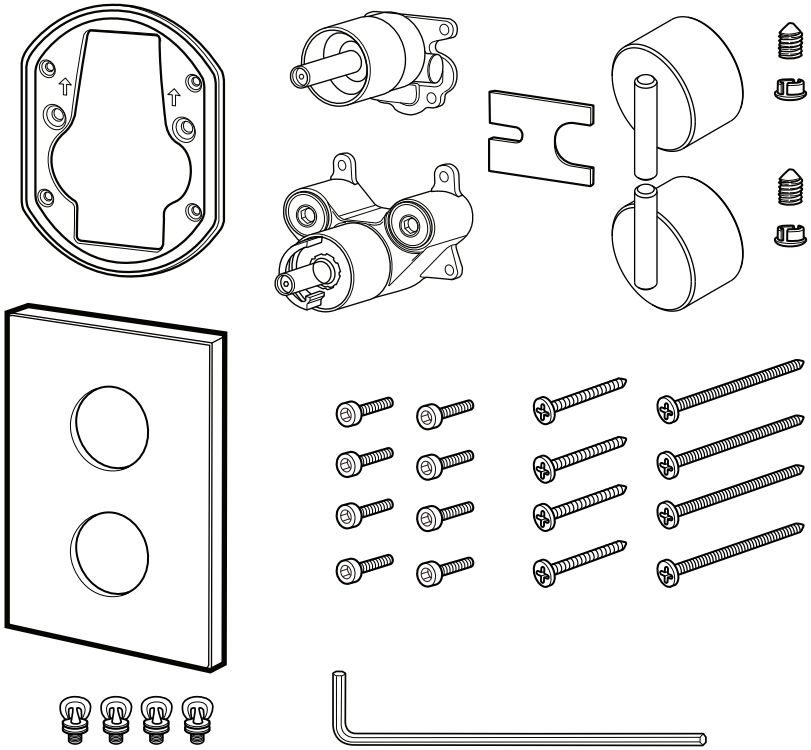


GB Mounting Instructions


1

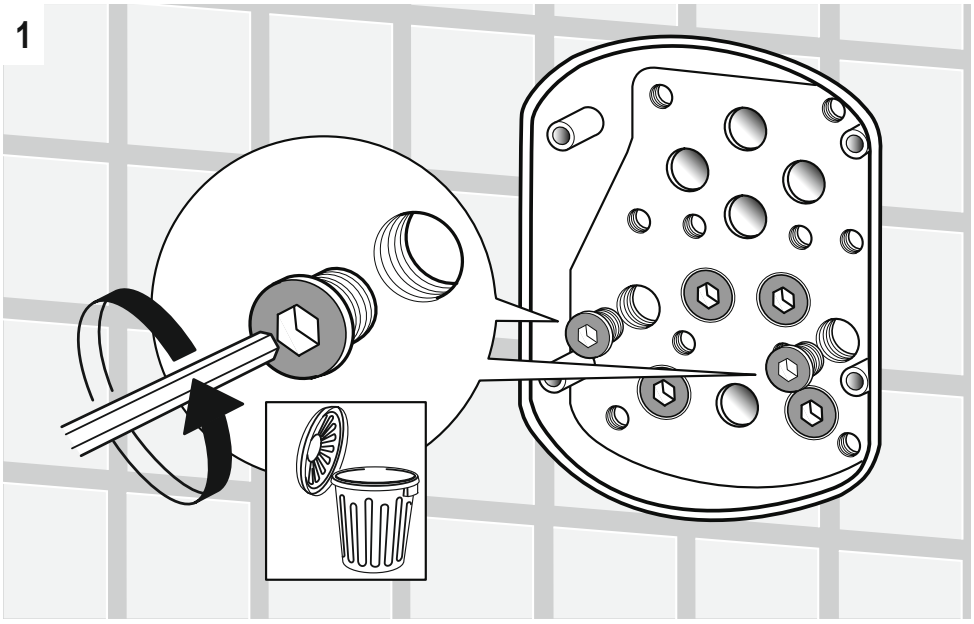


2

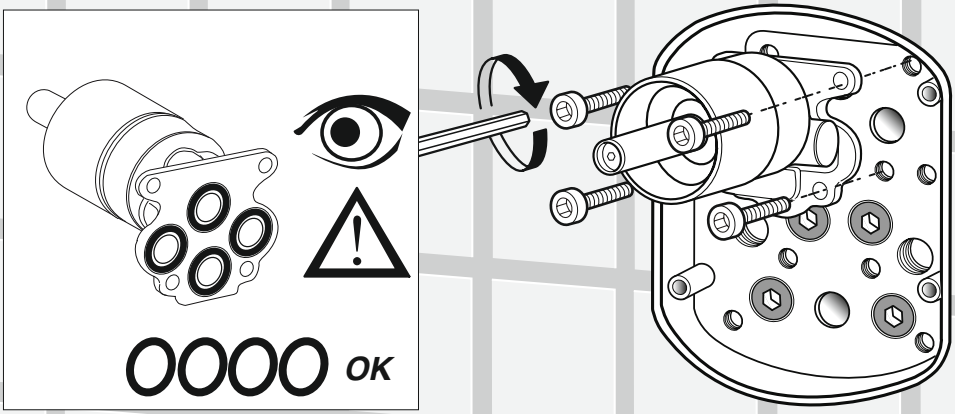



3

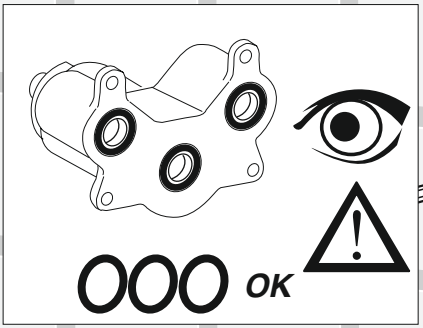


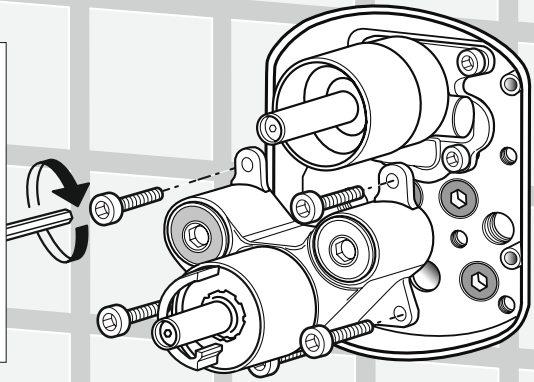



4

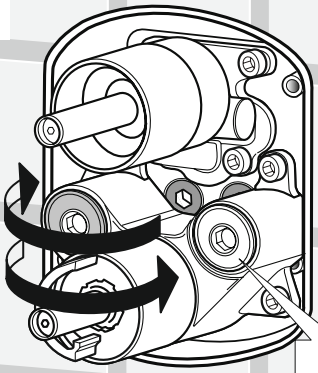

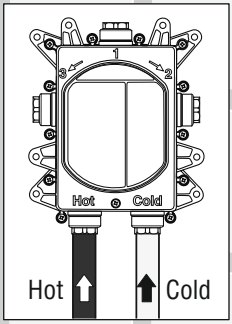

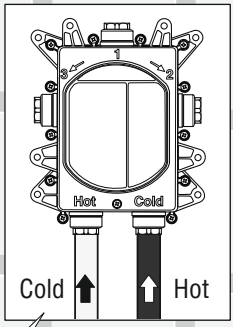







INSTALLATION



5

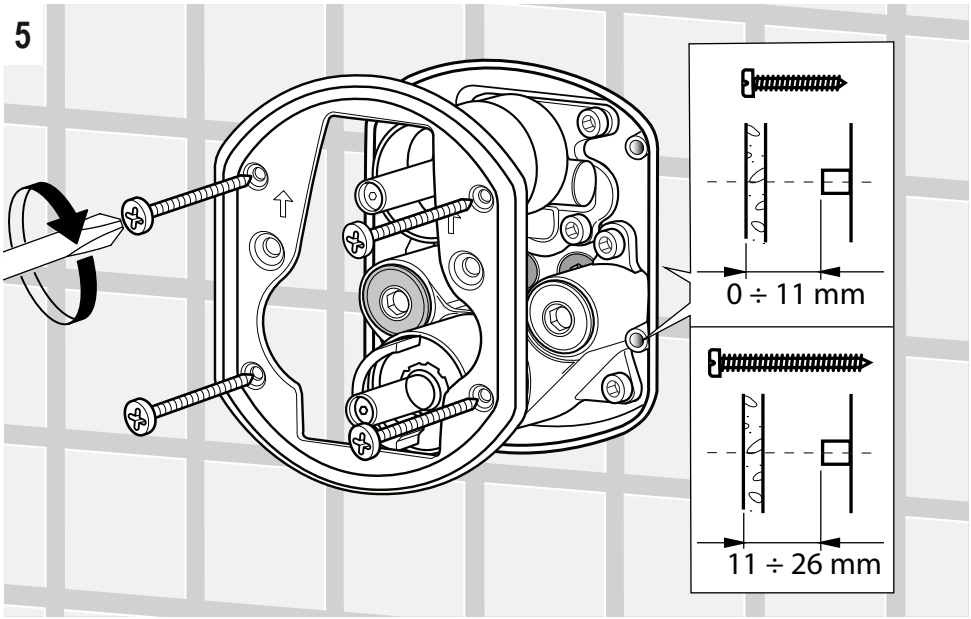



6A

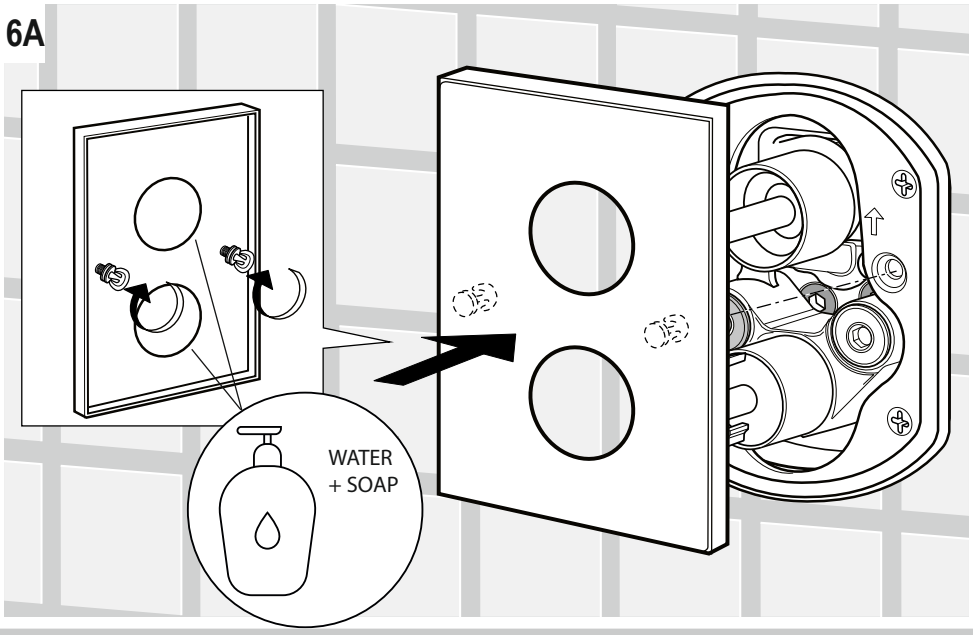

INSTALLATION




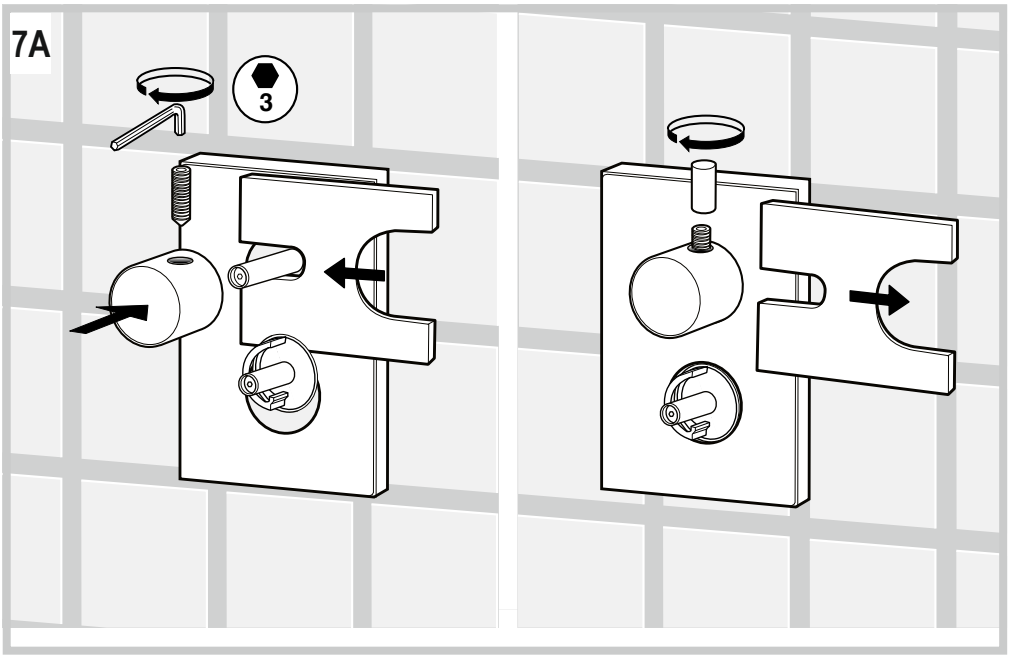

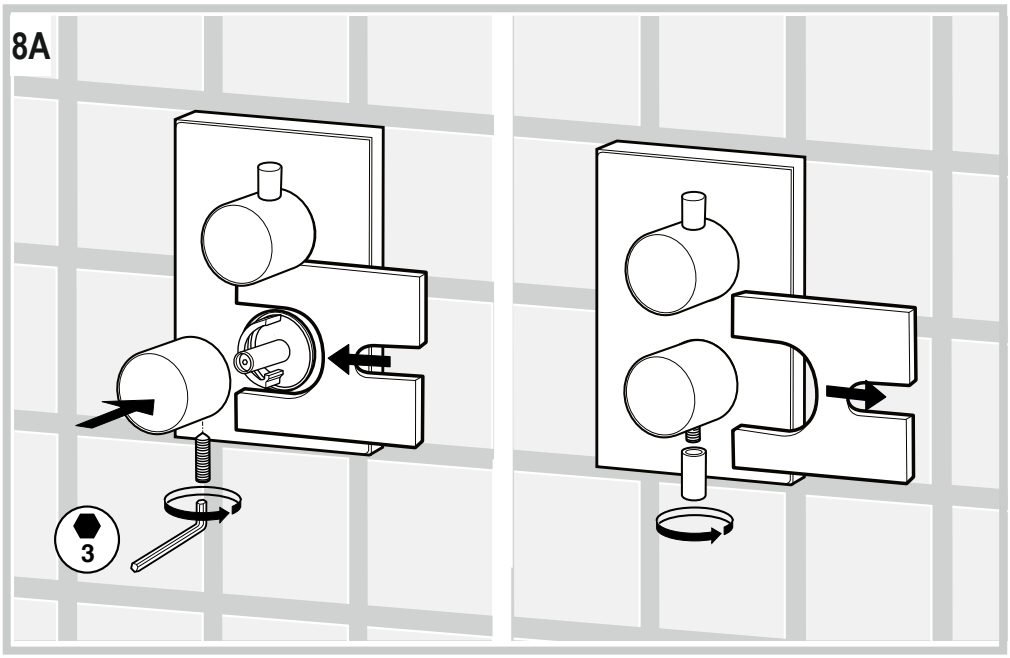


INSTALLATION

5

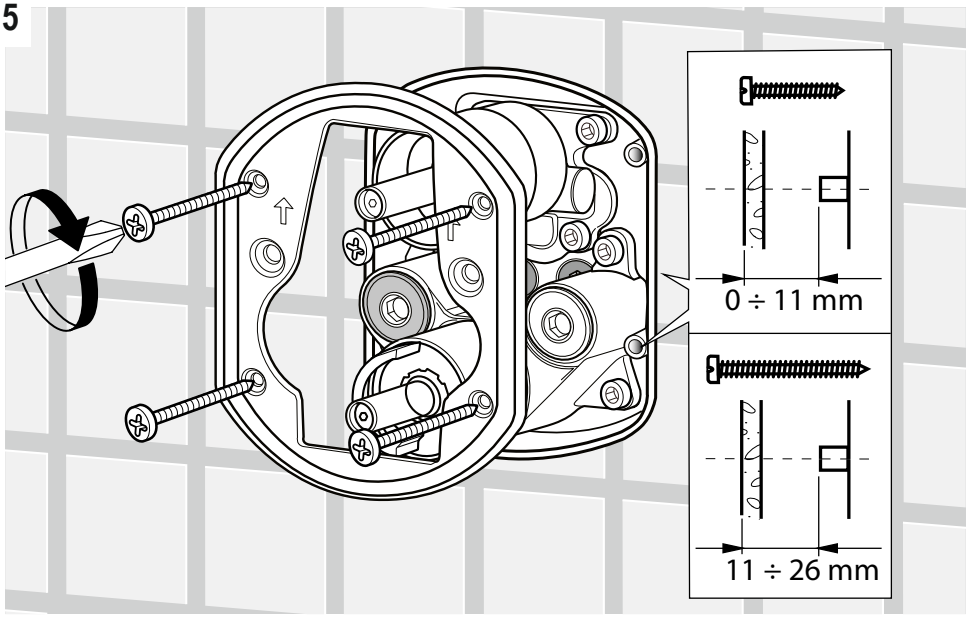


6B

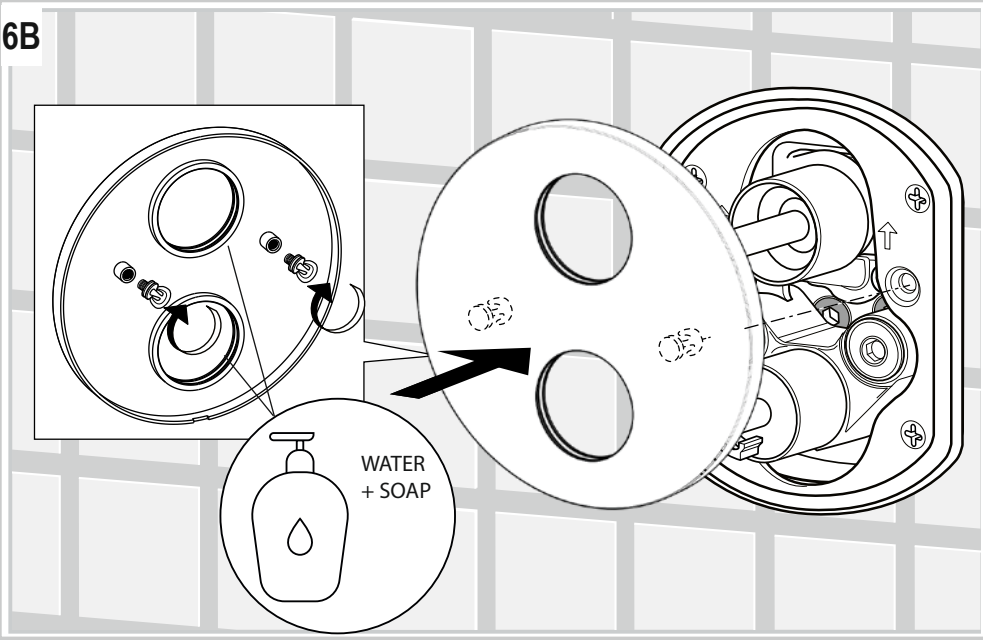


INSTALLATION

7B

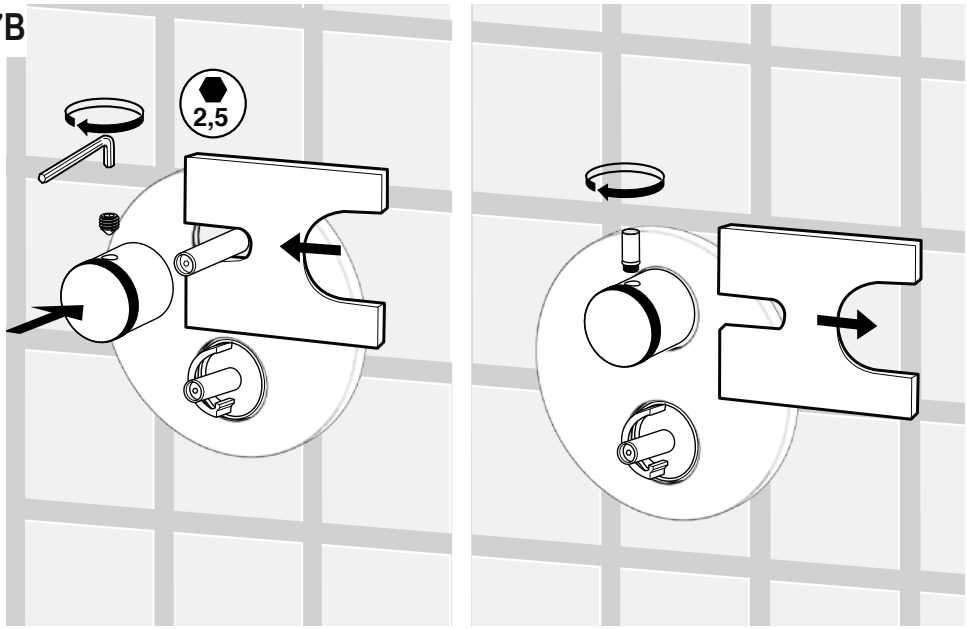


8B

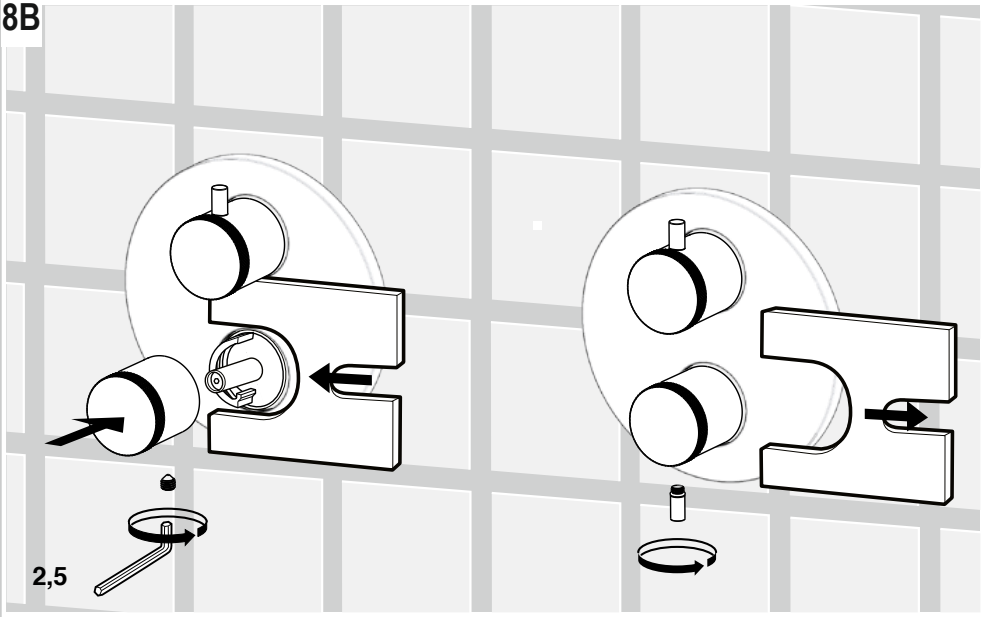


INSTALLATION

5

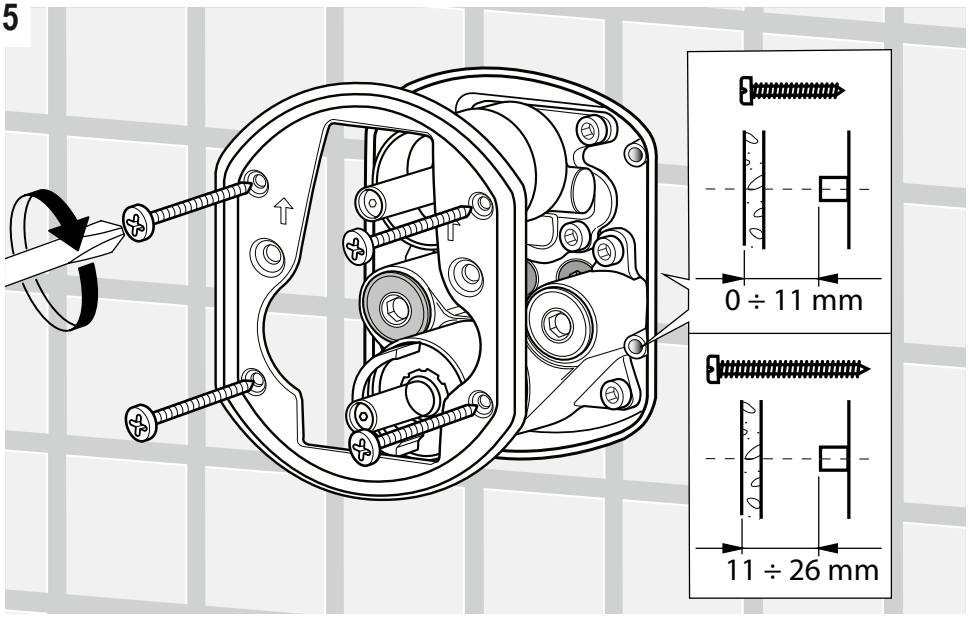



6C

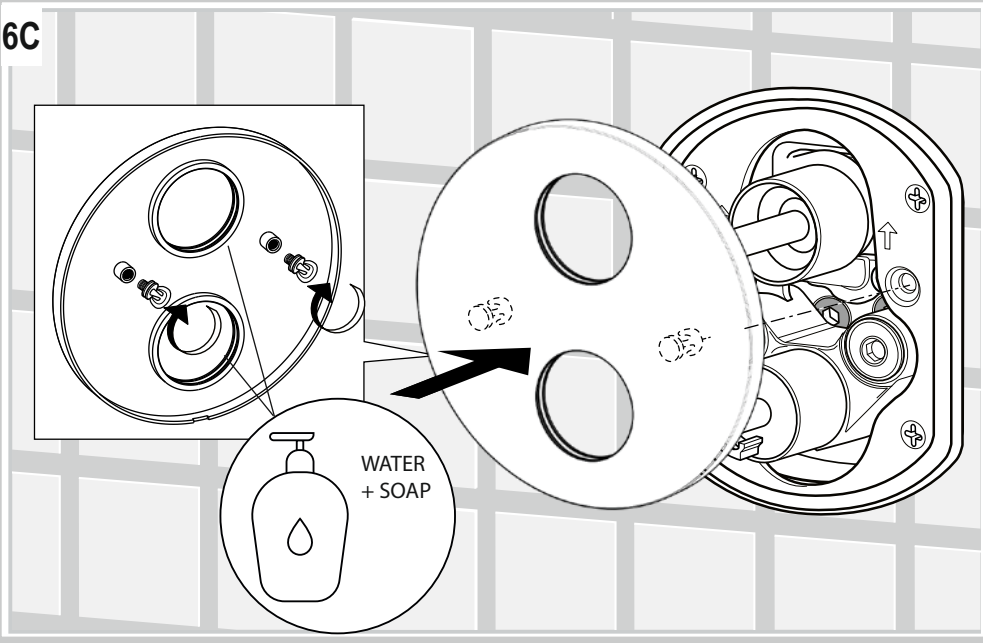


INSTALLATION



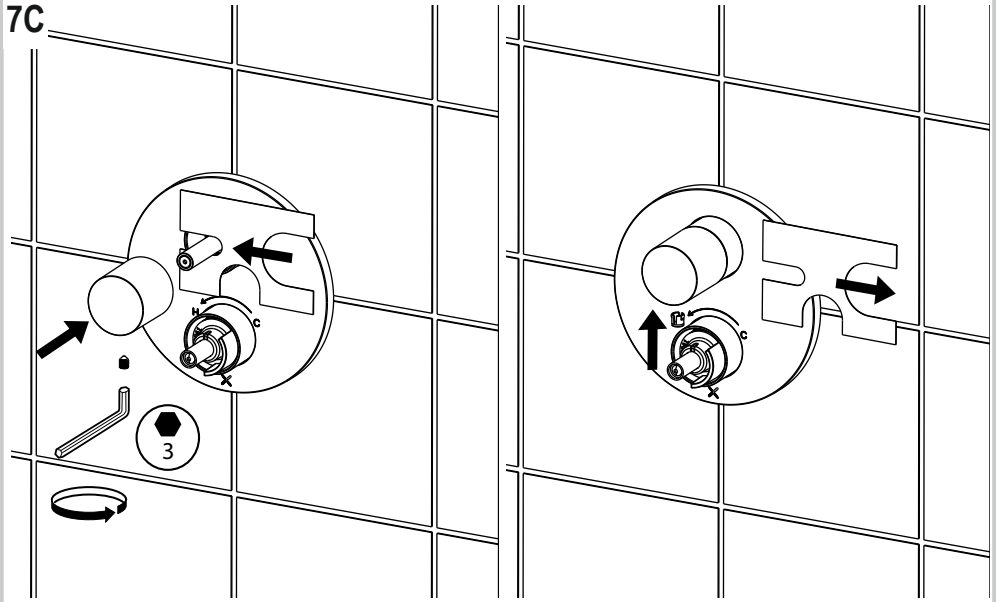


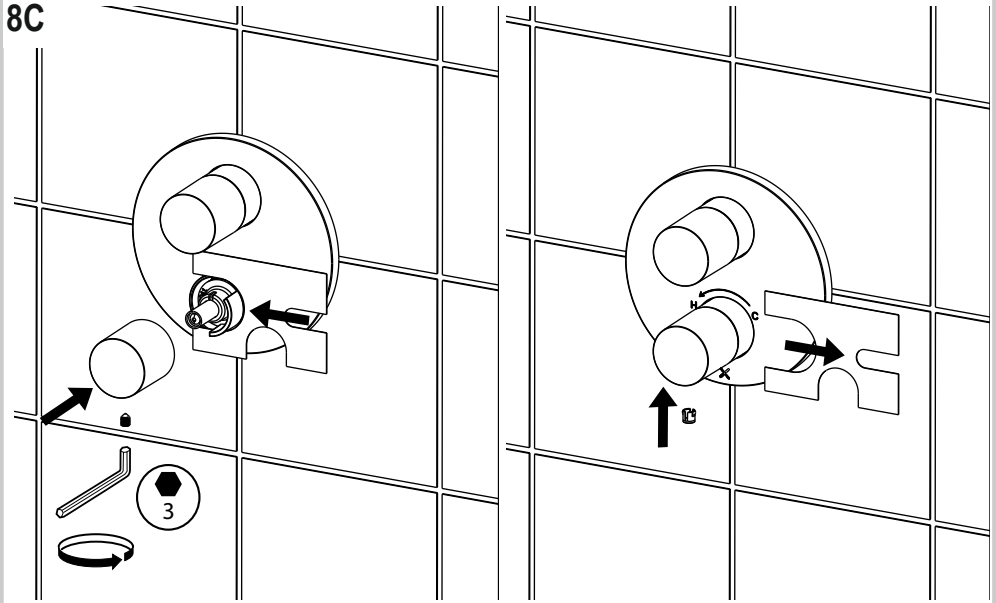


5

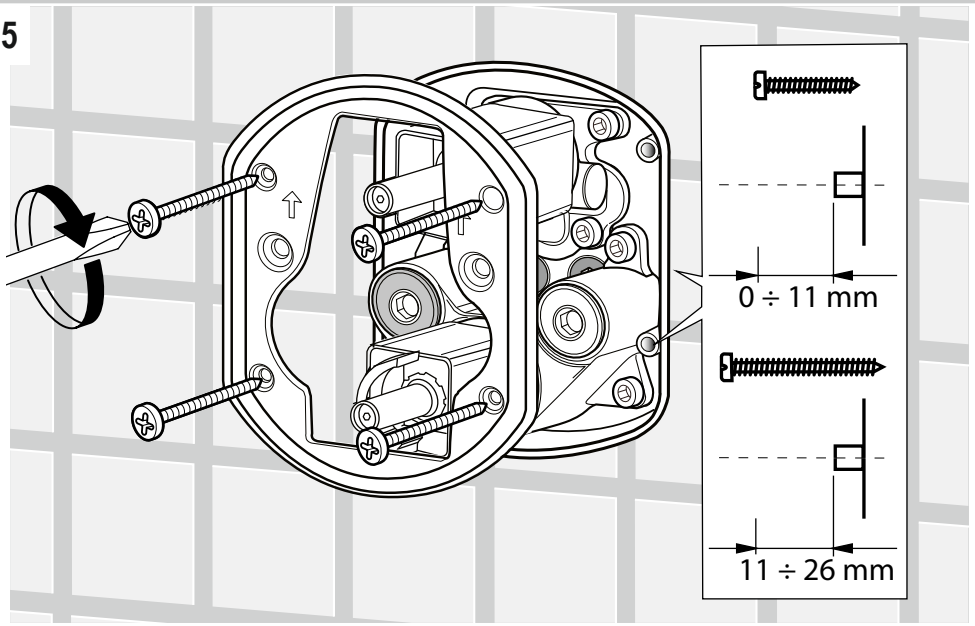


6D

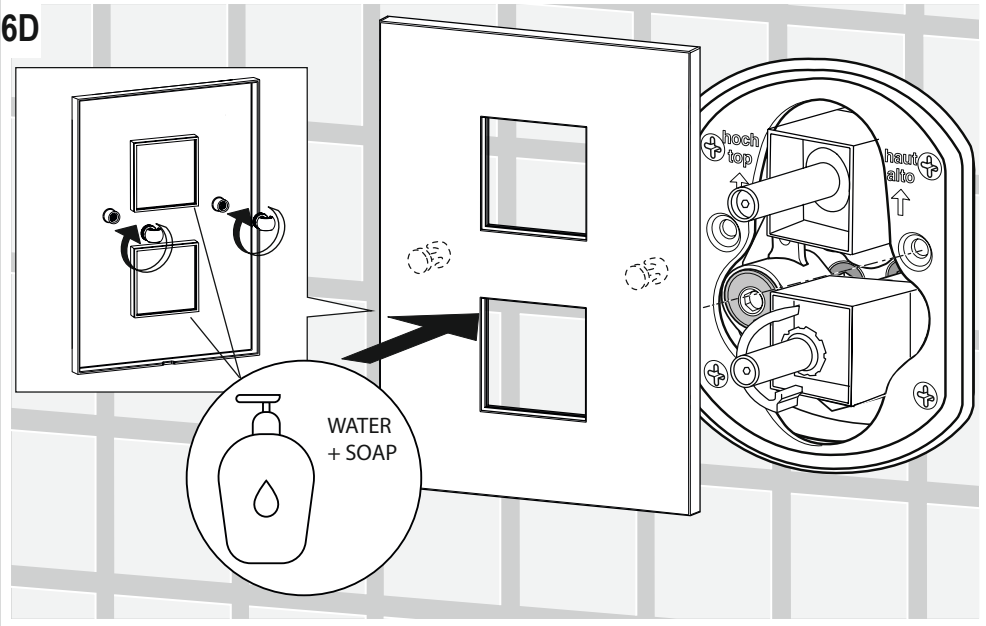


INSTALLATION



7D

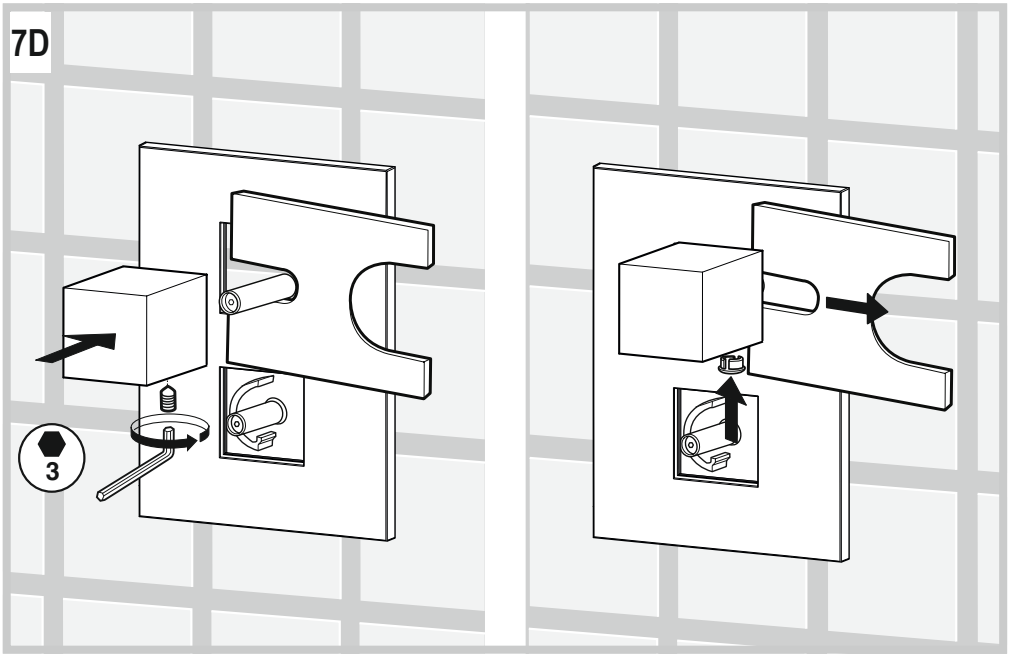


8D

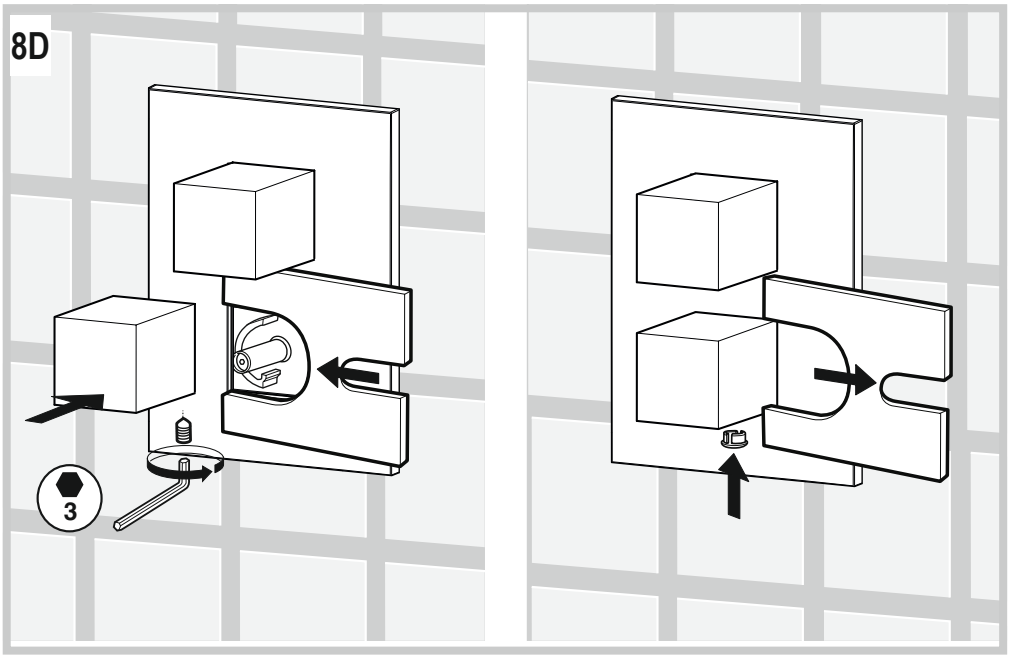




5

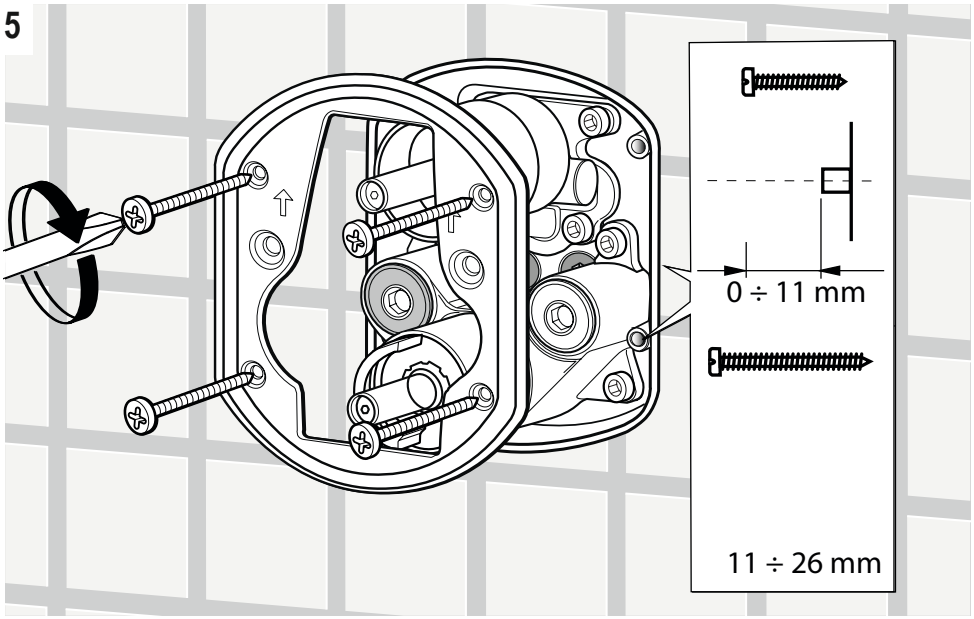


6E

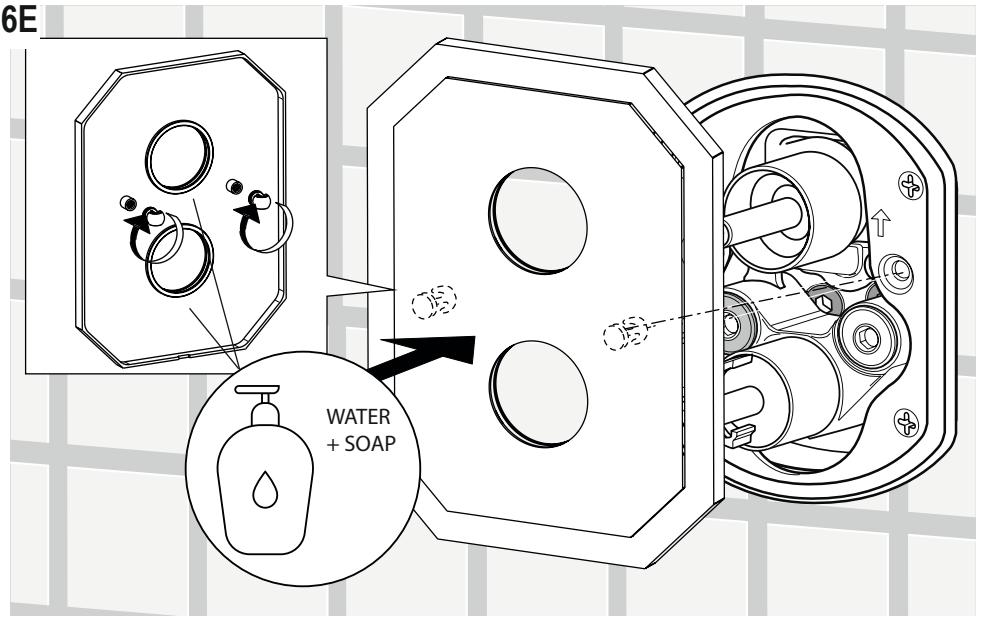


INSTALLATION




7E

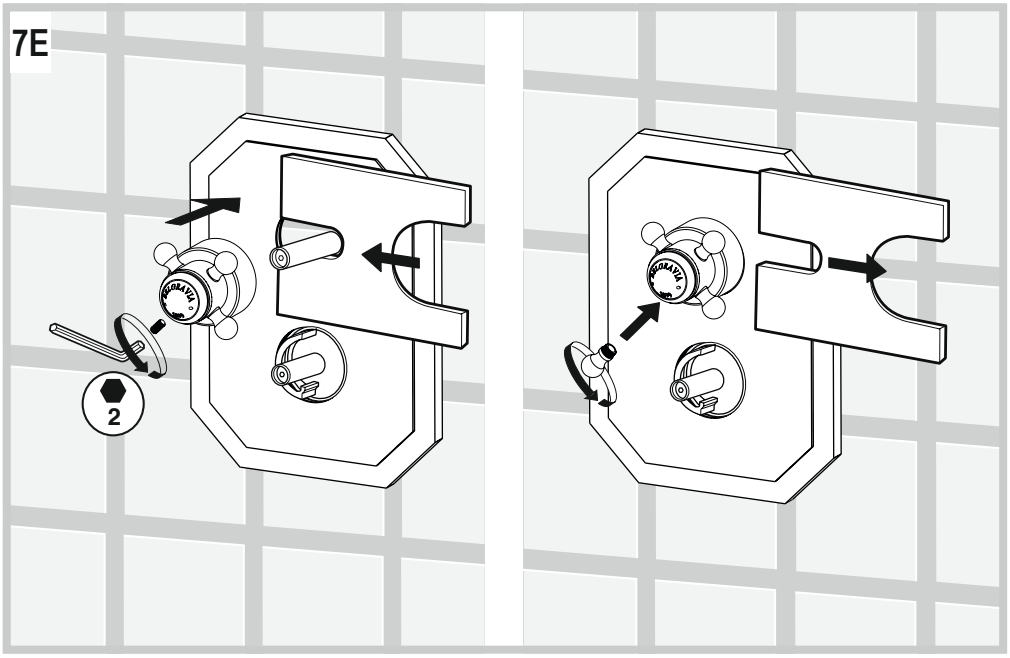


8E

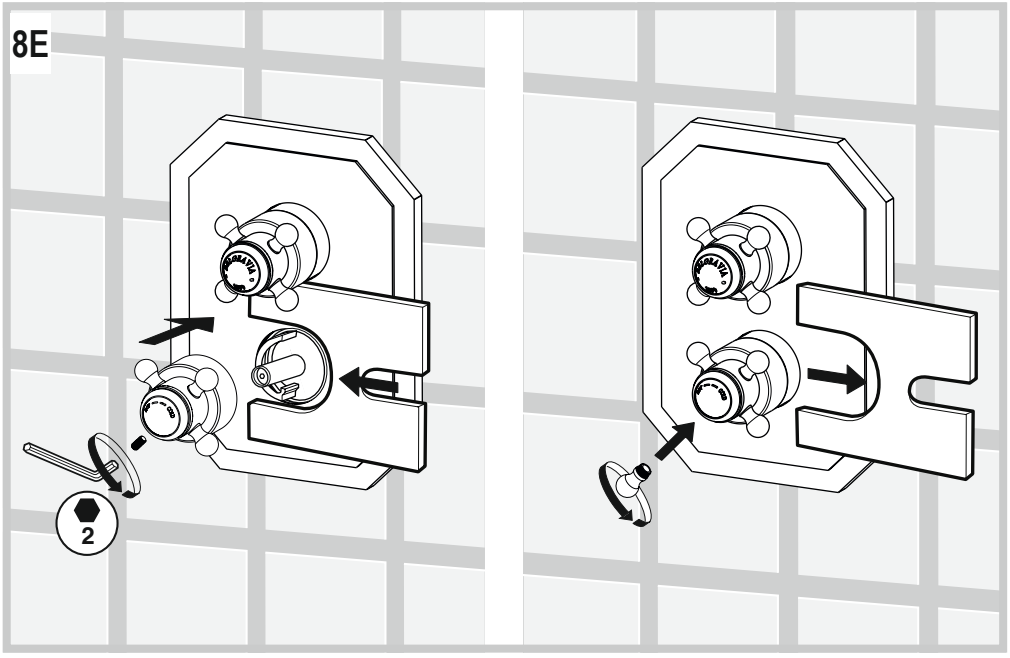


5

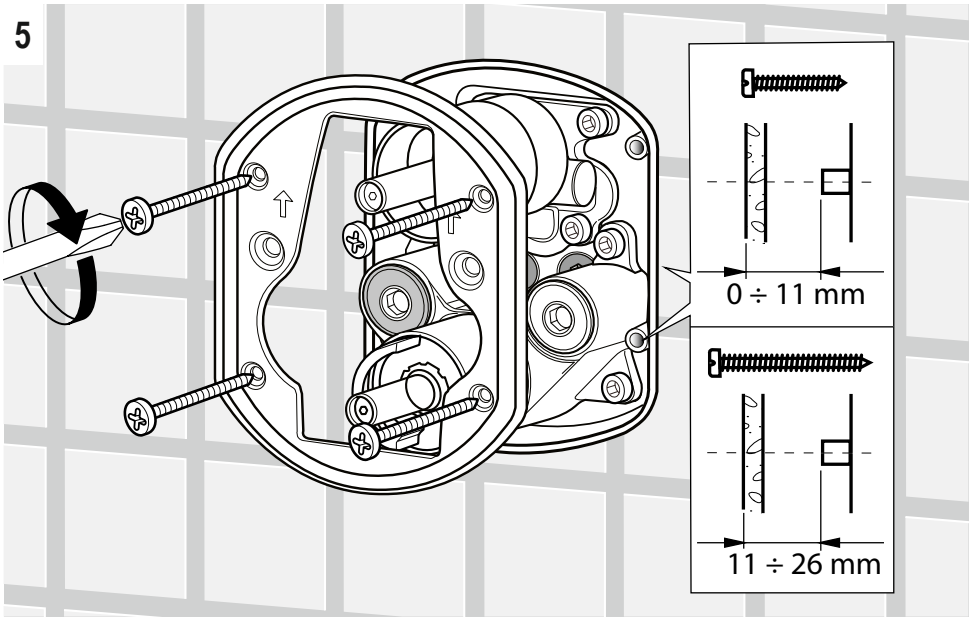


6F

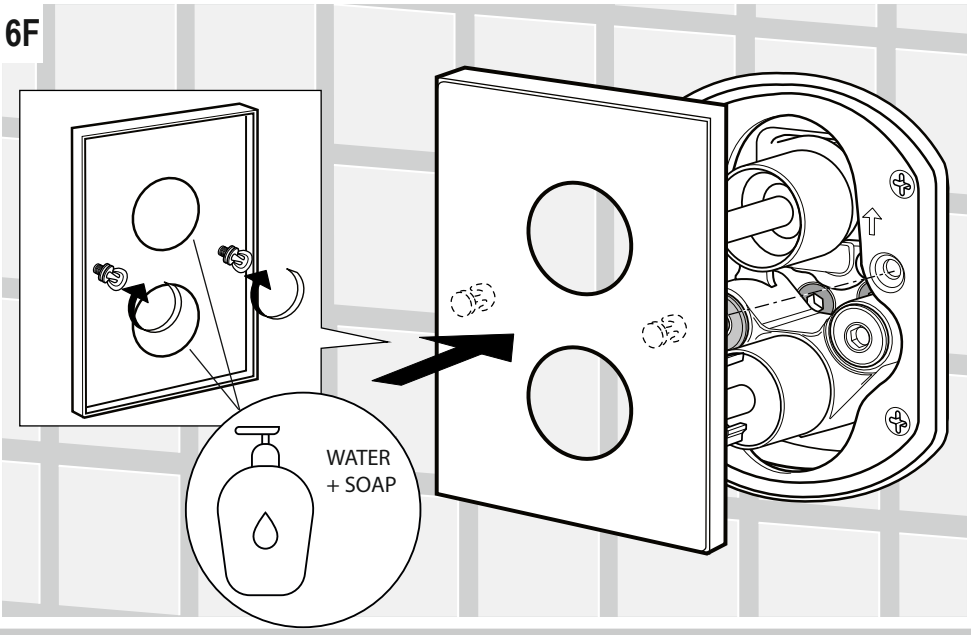


7F

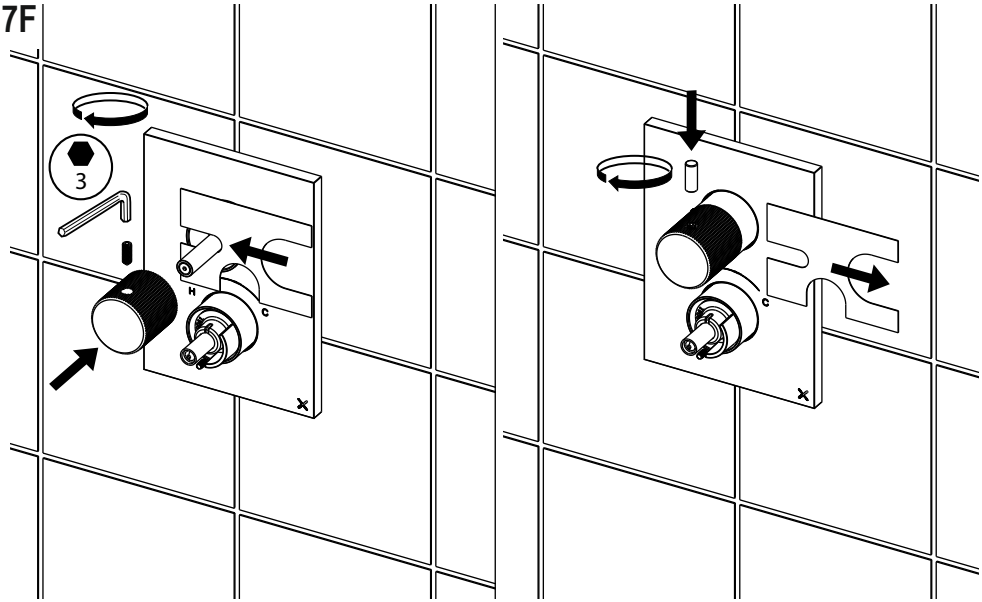


8F

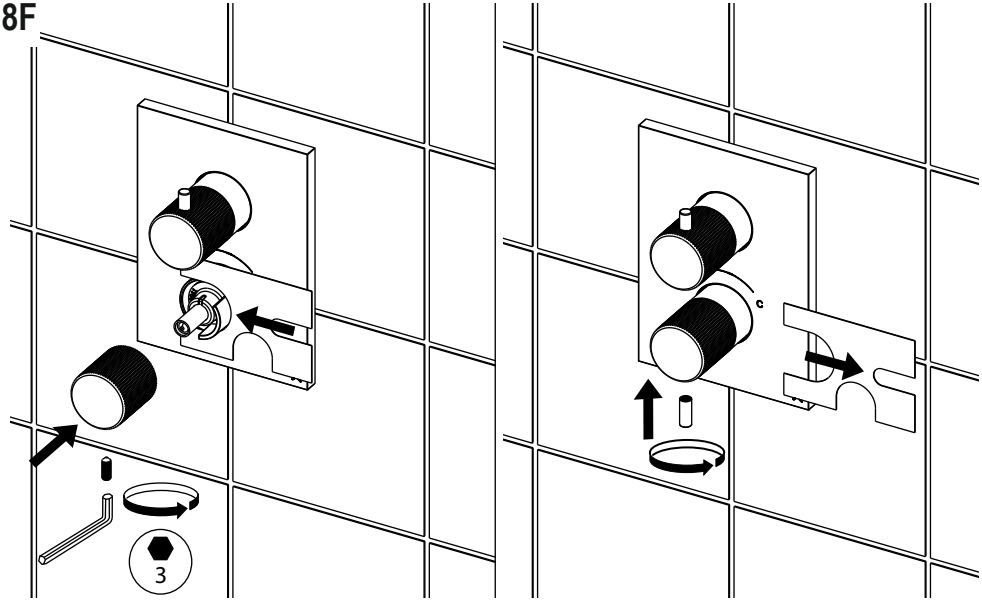

5

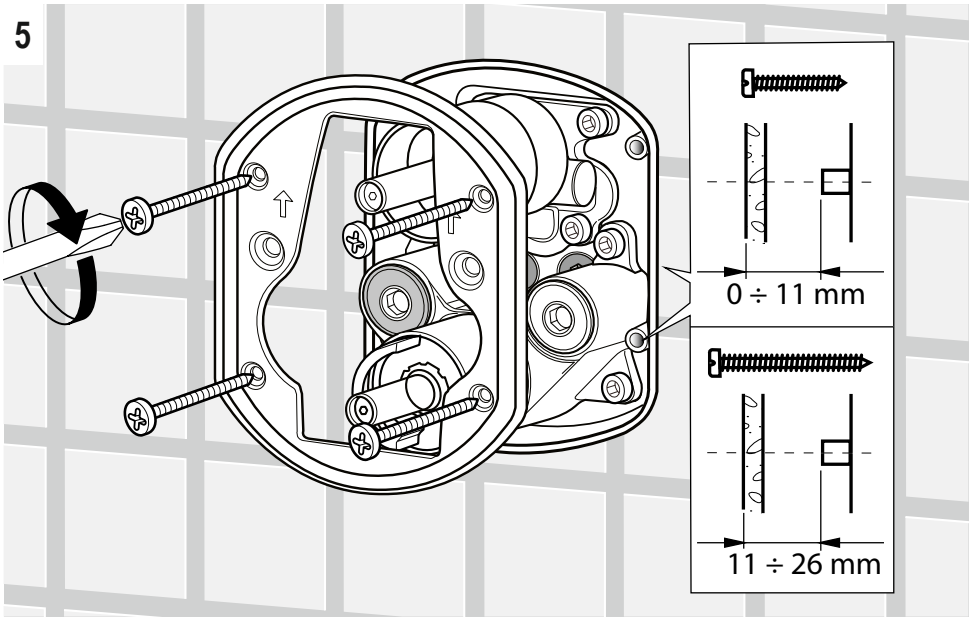


6G

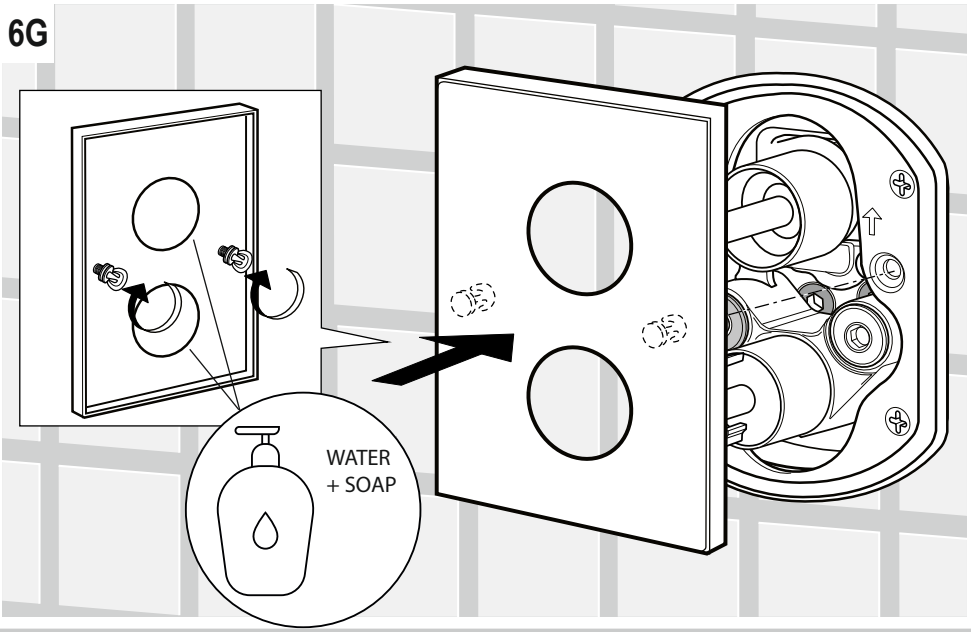


INSTALLATION


7G

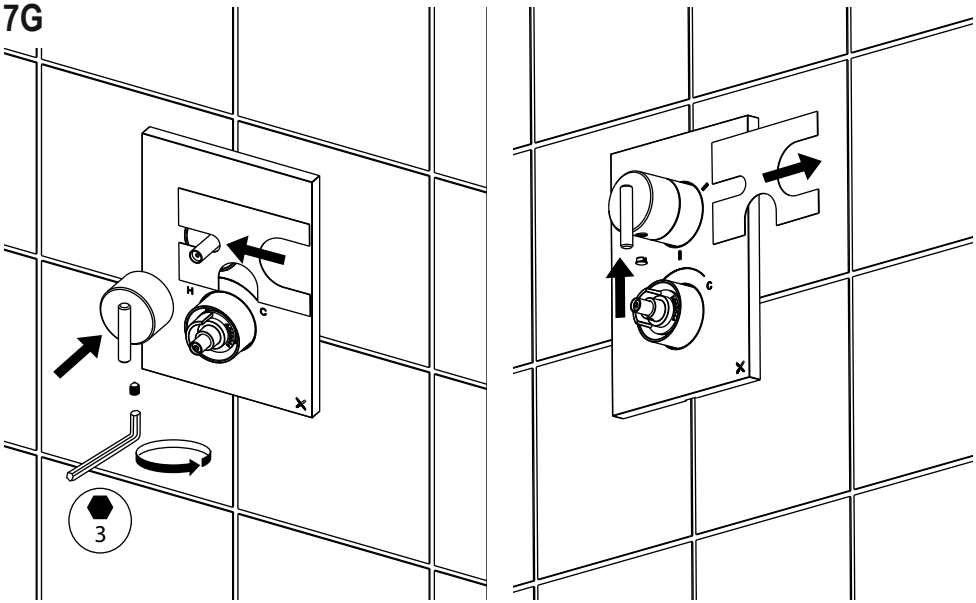


8G

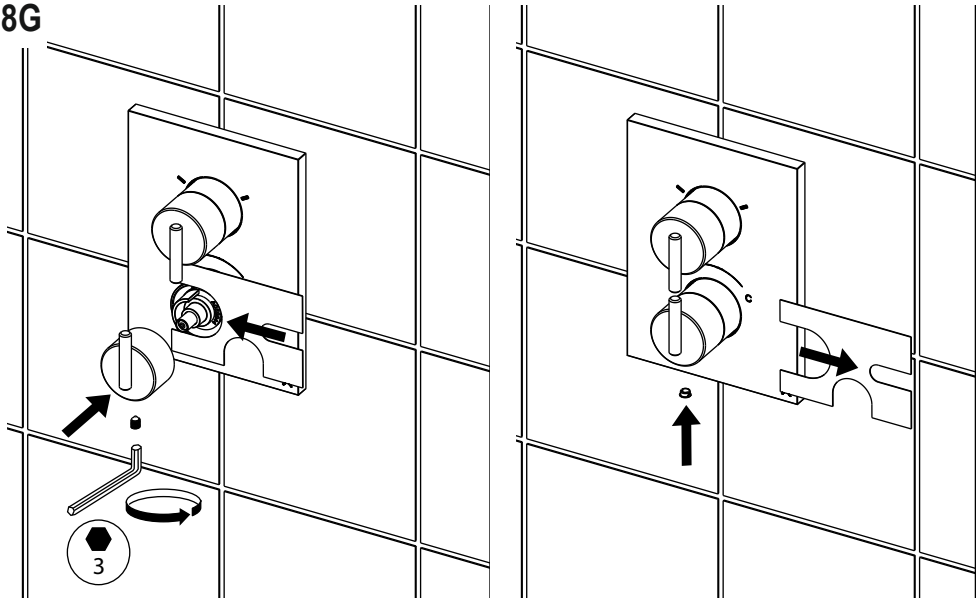



MAINTENANCE

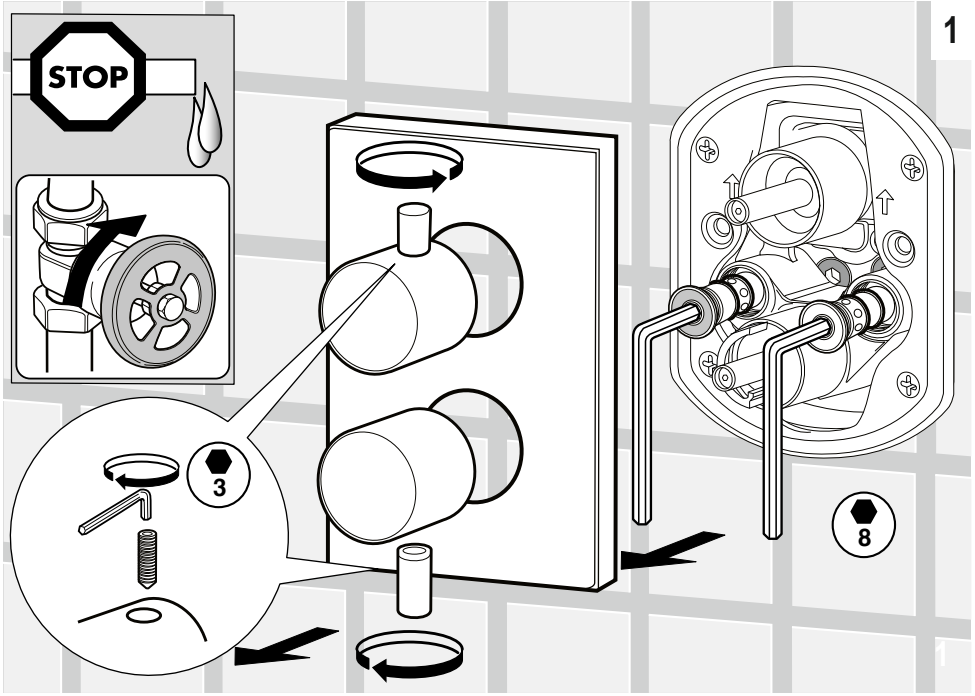


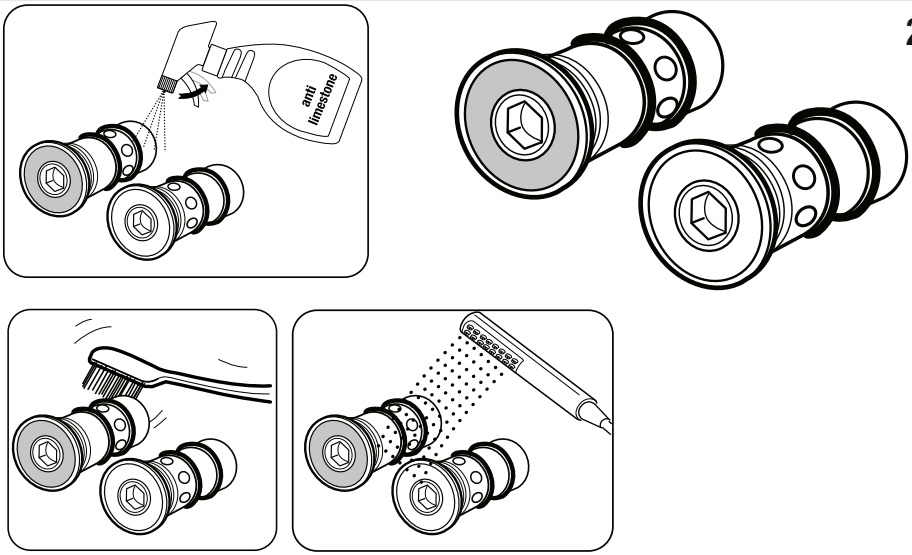


MAINTENANCE




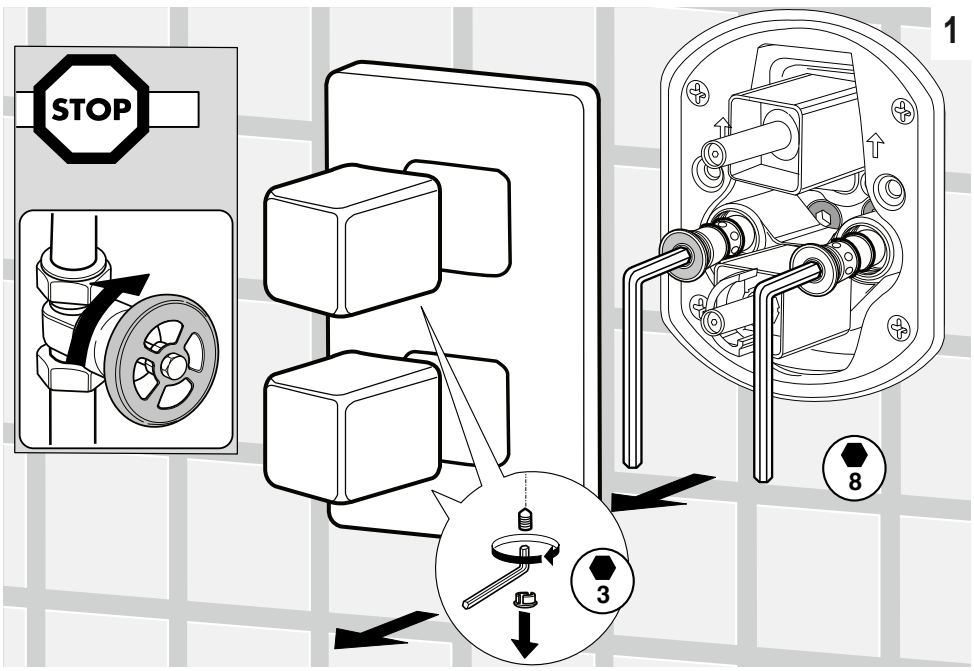

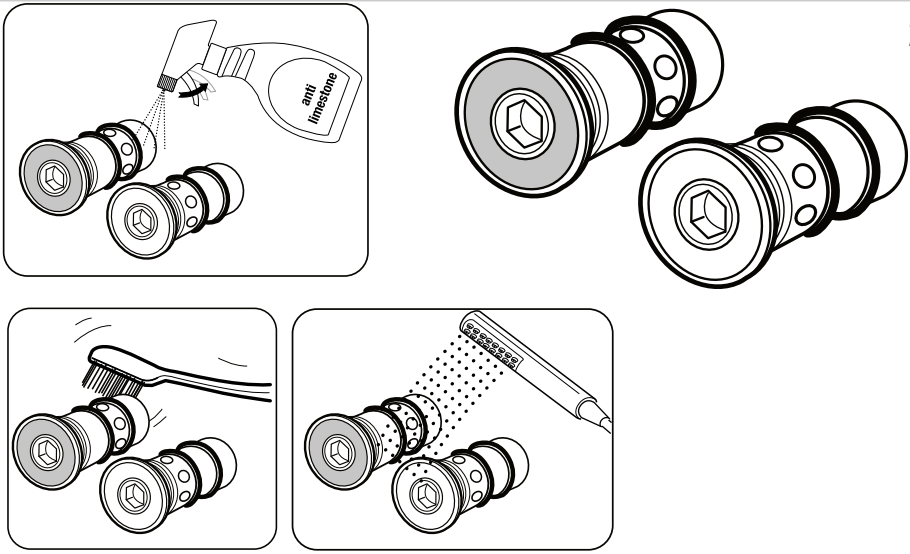



MAINTENANCE

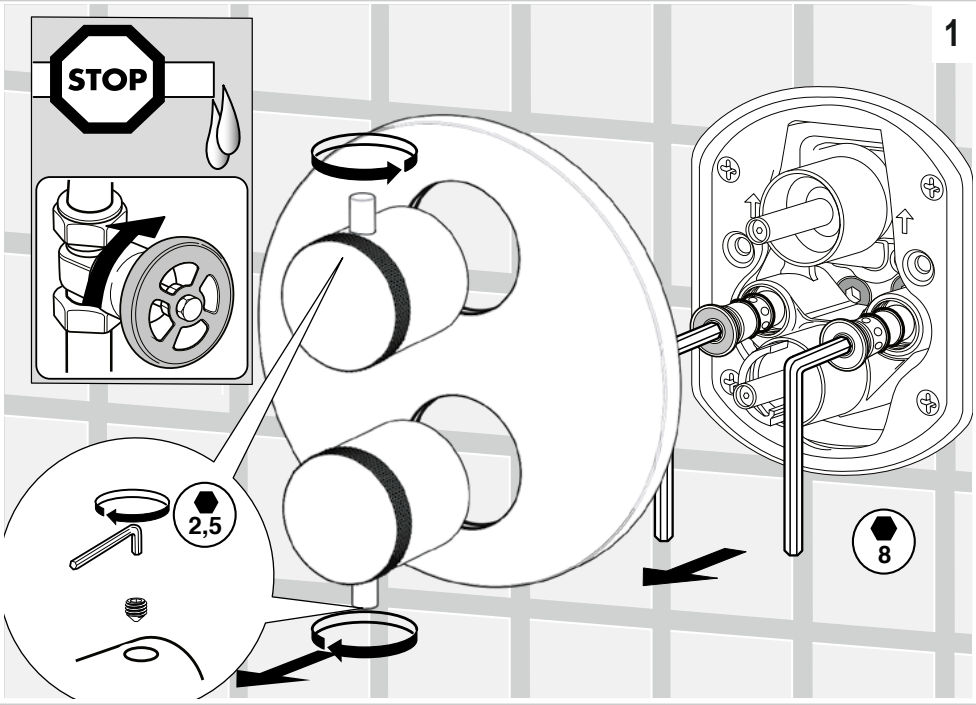

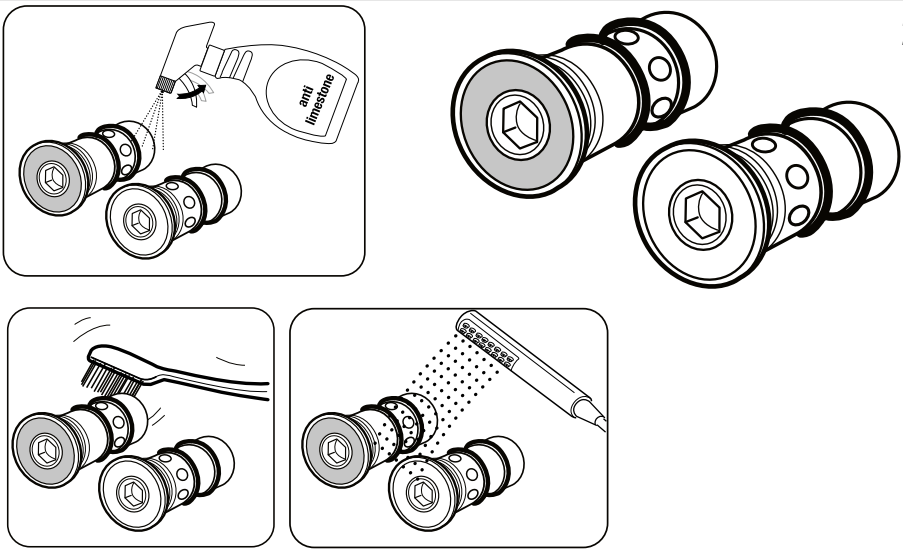


MAINTENANCE

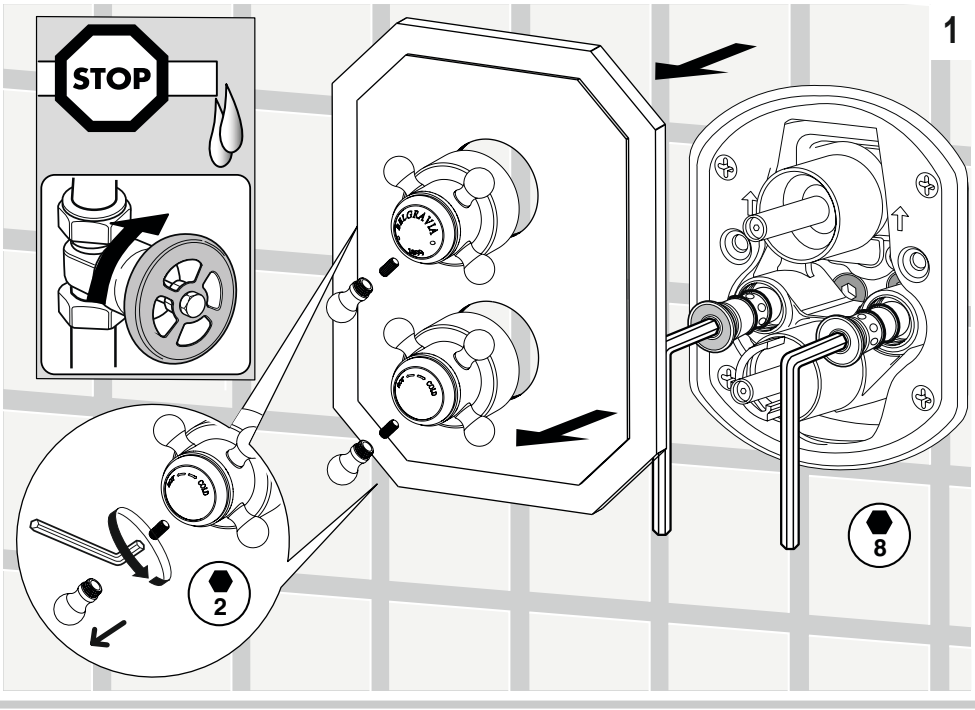


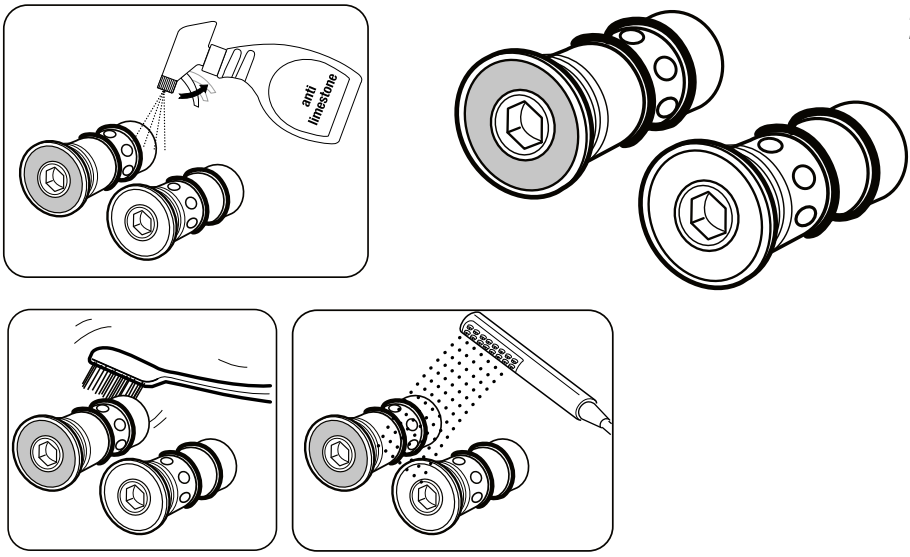

THERMOSTATIC 1 WAY

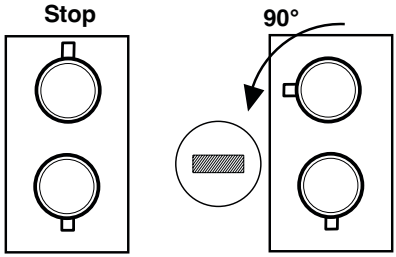

THERMOSTATIC 2 WAYS

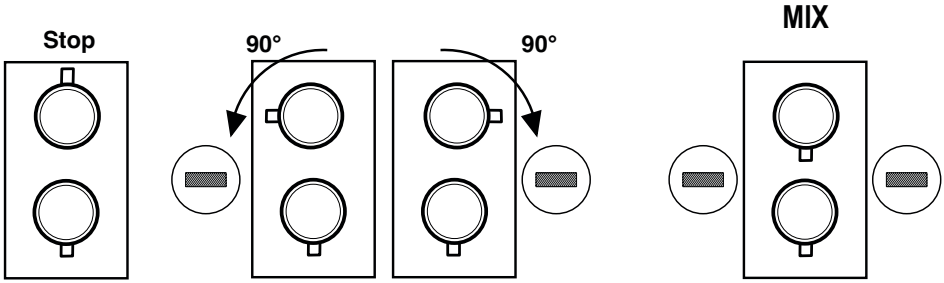

THERMOSTATIC 3 WAYS

